

SIEMENS



www.siemens.com/protection

SIPROTEC 5 Application Note

SIP5-APN-023:
Change setting groups via CFC

SIPROTEC 5 Application

Change setting groups via CFC

SIPROTEC 5 - Application: SIPROTEC 5 Change setting groups via CFC

Content

1	SIPROTEC 5 Change setting groups via CFC	3
1.1	Introduction	3
1.2	Example	3
1.2.1	Applying setting groups	3
1.2.2	Signals from parallel line	4
1.2.3	CFC logic for Setting Group Selection	5
1.3	Conclusion	7

1 SIPROTEC 5 Change setting groups via CFC

1.1 Introduction

In some applications it is beneficial to have more than one Setting Group in the device. Based on system conditions the appropriate setting group is then selected. The selection of the setting group may be implemented with binary inputs or control inputs via interface. In some cases the selection will be implemented based on conditions derived from a user defined logic implemented with CFC in the device. This application note will show how the CFC logic interfaces with the Setting Group selection.

1.2 Example

The example will focus on the method used in CFC to select a setting group. For illustration an application with 3 Setting Groups is used. The table below describes the applied setting groups:

Setting Group	Description	Activation Criteria
Setting Group 1	Active when both lines are in service and connection in parallel at remote bus	Parallel Line in Service AND Parallel connection at remote bus
Setting Group 2	Active when only one line is in service or when remote bus connection is to separate bus-sections	Parallel Line open OR NO parallel connection at remote bus
Setting Group 3	Active when parallel line is out of service and grounded	Parallel Line open AND Grounded at both ends

Table 1: Definition of Setting Groups

1.2.1 Applying setting groups

SIPROTEC 5 supports up to 8 setting groups. To apply more than one setting group the desired number of setting groups must be entered under Settings/Device settings as shown in the diagram below:

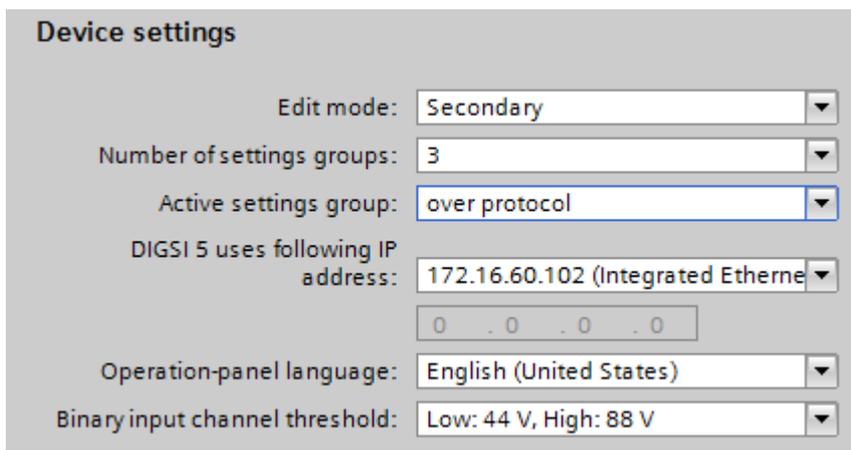


Figure 1: Enter the number of desired Setting groups

The “Active setting group” parameter must be set to “over protocol” if the selection is done via CFC. If this is not done the CFC described below will not change the setting groups as desired.

SIPROTEC 5 Application

Change setting groups via CFC

Once the application settings have been applied to one of the Setting Groups, this setting group can be copied to the other setting groups. It is therefore only necessary to apply the settings that deviate from the initial set in the other setting groups. In this example only the parameter XE/XL and RE/RL is different in the three setting groups.

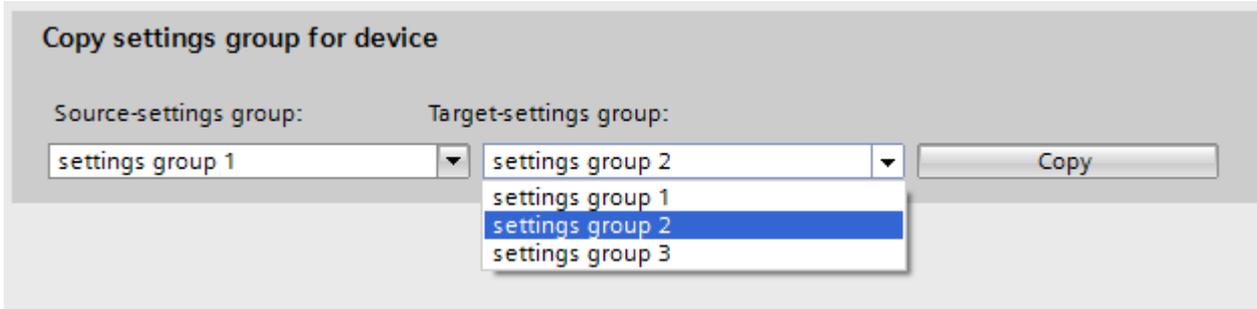


Figure 2: Copy original Setting group into the other setting groups

To change settings in a particular setting group, the setting group must be selected under “Values for change”, see diagram below.

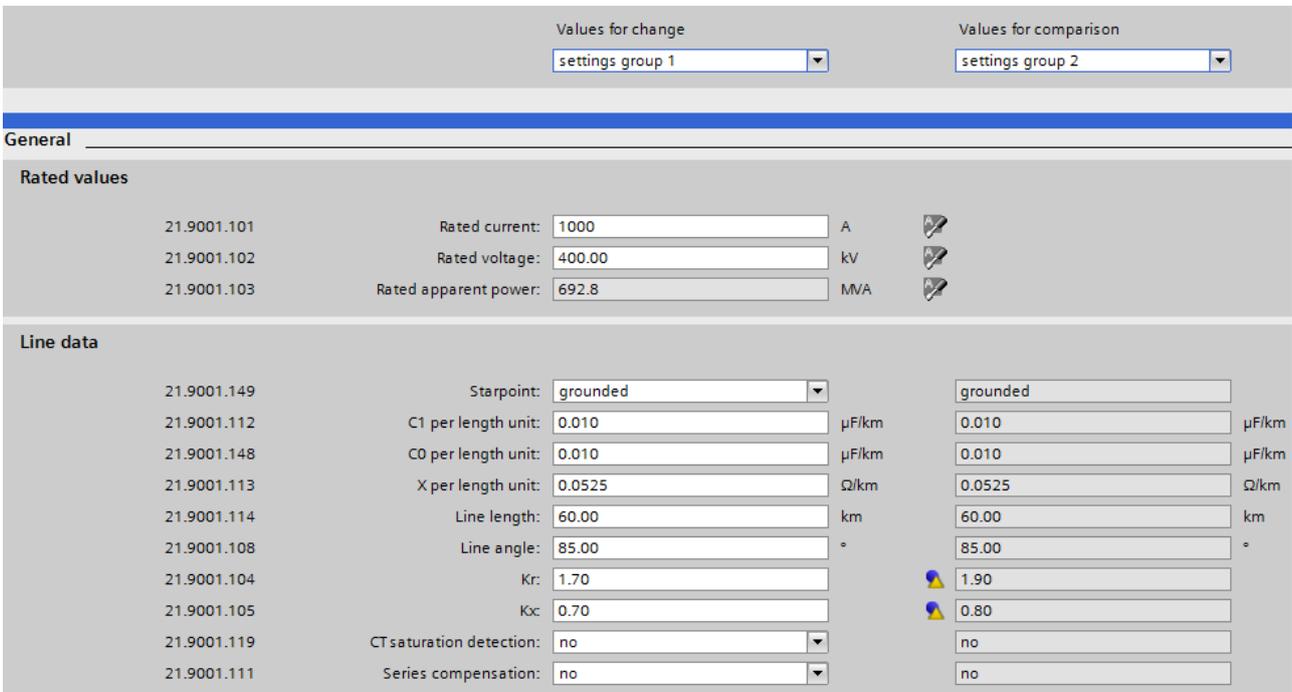


Figure 3: Changing and comparing settings of the setting groups

It is possible to compare the settings with one of the other setting groups. Deviations are highlighted.

1.2.2 Signals from parallel line

For the example the following status signals are obtained from the parallel line:

- Parallel Line in service
- Parallel Line out of service
- Remote connection parallel
- Parallel Line grounded at both ends

For purpose of the example, the information from the parallel line is derived via binary inputs. The signals could also be derived from other sources, e.g. GOOSE, Protection Interface or System Interface.

Signals	Number	Type	4	3.5	3.6	3.7	3.8
(All)	(All)
▶ Res. LED not in Grp.	7411						
▼ Parallel Line	6361		*	*	*	*	
▶ Mode (controllable)	6361.51	ENC					
▶ Behavior	6361.52	ENS					
▶ Health	6361.53	ENS					
▶ In Service		SPS	H				
▶ Out of Service		SPS		H			
▶ Remote Parallel		SPS			H		
▶ Grounded		SPS					H

Figure 4: Routing of information from parallel line

1.2.3 CFC logic for Setting Group Selection

The logic diagram (CFC) shown on the next page is used to select the Setting Groups as defined in Table 1. Care should be taken to prevent the selection of two setting groups at the same time (the result will then depend on the run sequence of the logic).

The SPC_DEF and SPC_EXE modules must be applied as shown. Note the applied inputs at the “VAL” and “OPERATE” inputs of the SPC_DEF modules.

The corresponding SPC, e.g. Act. Settings group 2, must be routed to the “ID” input of the SPC_DEF module.

The status outputs of the SPC_EXE modules may be used to indicate the “Health” of the Setting Group selection (this is optional).

SIPROTEC 5 Application

Change setting groups via CFC

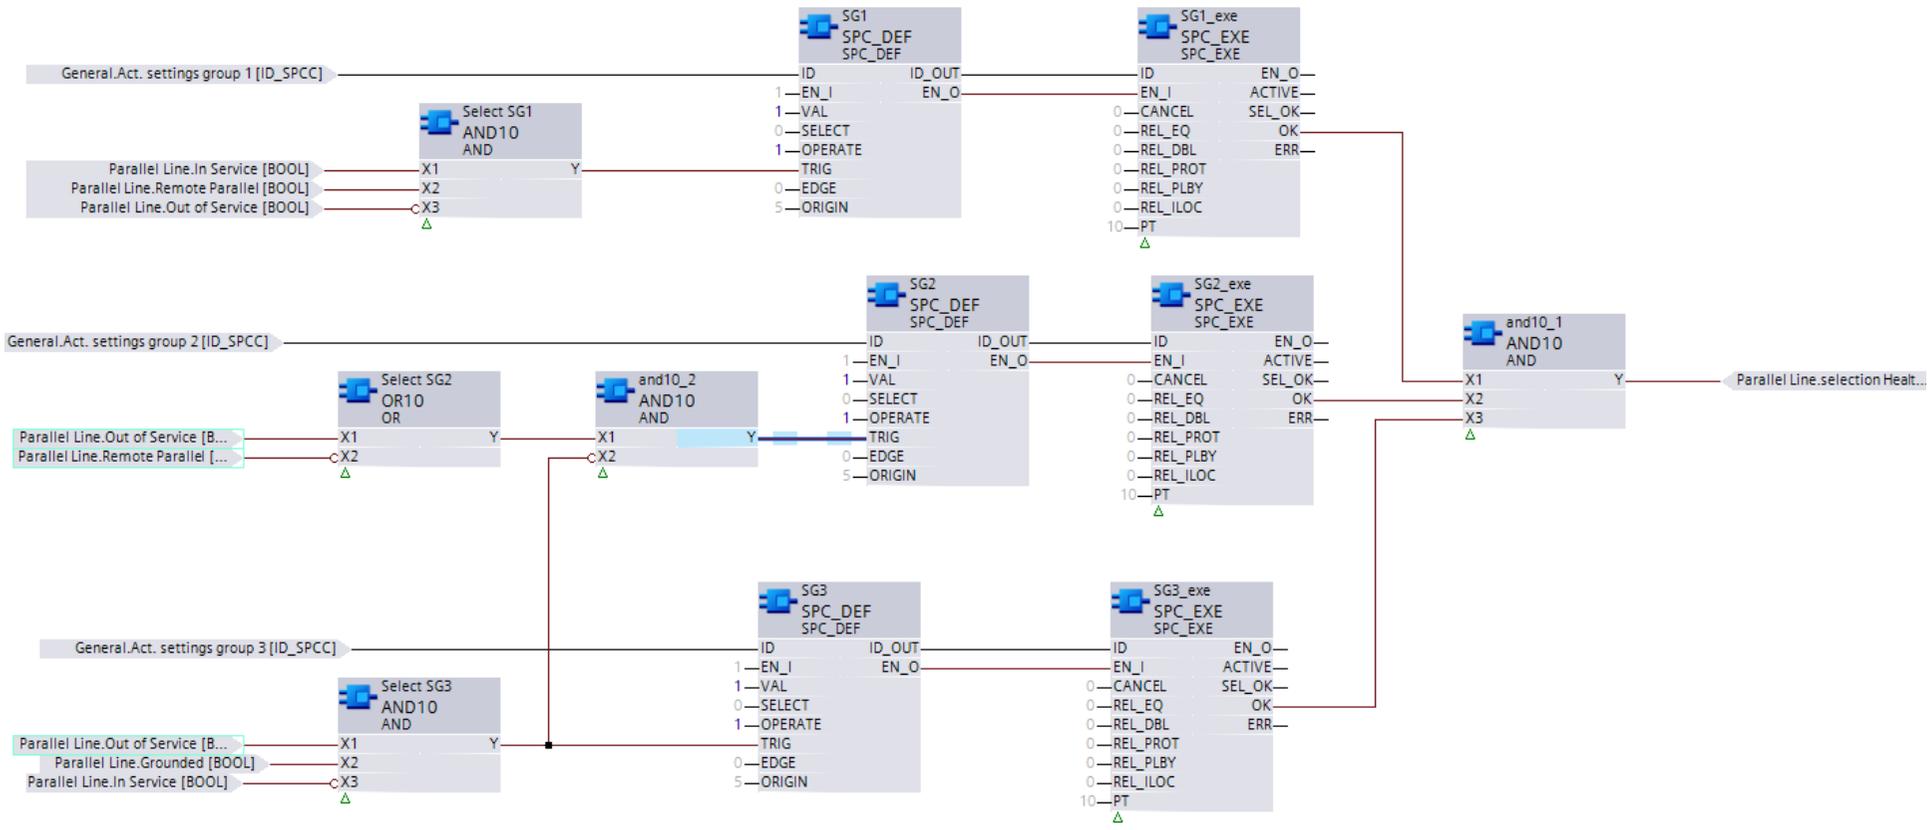


Figure 5: CFC chart for selection of Setting Group

1.3 Conclusion

By means of the SPC control for selection of the Setting Group, it is ensured that the selected setting group only changes when a new valid selection is established. The new selection resets the old selection "Radio Button". Care should be taken that the CFC does not select two Setting Groups at the same time.

Following a restart the device will initially use the last active setting group.

Published by and copyright © 2012:

Siemens AG

Infrastructure & Cities Sector

Smart Grid Division

Humboldtstr. 59

90459 Nuremberg, Germany

Siemens AG

Infrastructure & Cities Sector

Smart Grid Division

Energy Automation

Humboldtstr. 59

90459 Nuremberg, Germany

www.siemens.com/protection

Printed on elementary chlorine-free bleached paper.

All rights reserved.

If not stated otherwise on the individual pages of this catalog, we reserve the right to include modifications, especially regarding the stated values, dimensions and weights. Drawings are not binding.

All product designations used are trademarks or product names of Siemens AG or other suppliers.

If not stated otherwise, all dimensions in this catalog are given in mm.

Subject to change without prior notice.

The information in this document contains general descriptions of the technical options available, which may not apply in all cases. The required technical options should therefore be specified in the contract.

For more information, please contact
our Customer Support Center.

Tel.: +49 180 524 8437

Fax: +49 180 524 24 71

(Charges depending on provider)

E-mail: support.ic@siemens.com

Application note: SIP5-APN-023