

SIEMENS



www.siemens.com/protection

SIPROTEC 5 Application Note

SIP5-APN-005:
Protection Data Interface Application

SIPROTEC 5 Application

Protection Data Interface Application

SIPROTEC 5 - Application:

SIP5-APN-005

Protection Data Interface Application

Content

1	Protection Data Interface Application	3
1.1	Summary	3
1.2	Introduction	3
1.3	Offline Setting	4
1.3.1	Communication topology	4
1.3.2	Configuration assignment of device 1 in DIGSI 5	4
1.3.3	Configuration of device 2 in DIGSI 5	7
1.3.4	Principle of the data transfer via the protection interface	7
1.3.5	Assignment of signals to the PI - communication mapping	8
1.4	Test features and online supervision	9
1.4.1	Topology view in DIGSI 5	9
1.4.2	View of local and remote measurement values	10
1.4.3	Communication diagnostic editor	11
1.4.4	Loop Test	12

1 Protection Data Interface Application

1.1 Summary

Powerful integrated PI – interfaces can be used in communication applications for a fast exchange of binary data and measurements between devices. The concept of different priority levels and a guaranteed number of signals and transfer time within a priority level offers a deterministic communication approach. Signals received over a PI-interface may be distributed inside the substation over an IEC 61850 Ethernet network with GOOSE – messages. Parallel wiring required between devices e.g. for teleprotection applications can be done over communication links over long distances. Because signals can be freely assigned by the user applications can be adopted and replace inflexible hard wired traditional solutions.

Function integrated in external communication equipment can be used now with internal interfaces. Short and long connection fiber optical links are possible and also a communication over communication network by use of communication converters. Comprehensive supervision functions help to commissioning the system and to supervise it during operation. Failures and communication interruption are indicated immediately by the devices.

1.2 Introduction

The transfer of signals and measurement values between substations becomes more and more important. State of breakers, measurement values and other information will become more important in Smart Grid solutions where devices are communicating between each others or with decentralized data concentrators. Traditionally this is done with special teleprotection equipment or with expanded functions existing in line differential relays. Use of external equipment require additional wiring, testing and causes additional cost. If the devices can be interfaced directly to fiber optical links or communication networks the integration becomes much easier. This direct integration can be done by so called protection interfaces.

Each SIPROTEC 5 device can be equipped with one or two protection interfaces. The protection interface (PI – interface) allows a data exchange between different devices over serial point to point data connections from 64 kBit/s up to 2 MBit/s. Direct fibre optical links over different distances can be used or communication links over communication networks (e.g. SDH – network). Furthermore pilot wires can be used together with an external communication converter.

Devices connected over this links can be assigned to a communication topology with 2 – 6 devices inside such a topology. This topology can be a closed ring a chain structure. Within a topology the physical connection between the devices can have different baud rates. Depending on the available bandwidth and the applications going through this interface a certain amount of data objects can be transferred between the devices belonging to one topology. The connection with the lowest bandwidth limits the number of possible information objects. These objects can be assigned with DIGSI 5 to the PI-interfaces with a communication mapping. How this is done will be explained in the application.

The following services are available, transferred and supervised:

- Topology data for establishing and permanent supervision of connections. A ring topology can switch over to a chain topology and carry on its operation. Reason may a loss of connection or a logged out of a device due to maintenance reason.
- Protection data like differential protection, teleprotection signals and binary signals and measurement values. Some measurements are transferred with there amount and phase.
- Time synchronization: One device of the topology can time sync. the other devices with a high accuracy.
- The connection will be supervised for data disturbances; loss of connection and the delay time over the links is measured and supervised permanent. If the devices are time synchronized with a high accurate second pulse on each end the delay time can be calculated independent for the transmit and receive direction. Indications and supervision values are available permanent.

SIPROTEC 5 Application

Protection Data Interface Application

- Remote devices can be interrogated with DIGSI 5 over the PI-link. In this case the channel is used for DIGSI 5 communication exclusively and the Protection Data communication will be switched OFF. This allow e.g. to change settings of remote devices without moving to the remote location.

The PI – interface is available with two types. Type 1 is used for devices with a differential protection function (7SD8x and SL8x). The other type 2 is used for all other devices and allows transferring a huge amount of binary signals and measurements between the devices even if a low bandwidth connection with 64 kBit/s is available.

This application focus on a two terminal configuration with two devices communicating over a PI-interface.

1.3 Offline Setting

1.3.1 Communication topology

For a two terminal configuration each device must be equipped with a PI - interface. Module position F is used and an 820 nm fiber optical USART – module realize the direct fiber optical connection. Only one channel of this module is necessary for a two terminal PI – connection. Channel 2 may be used as spare channel or for a serial connection to a substation automation system using e.g. IEC 60870-5-103 protocol.

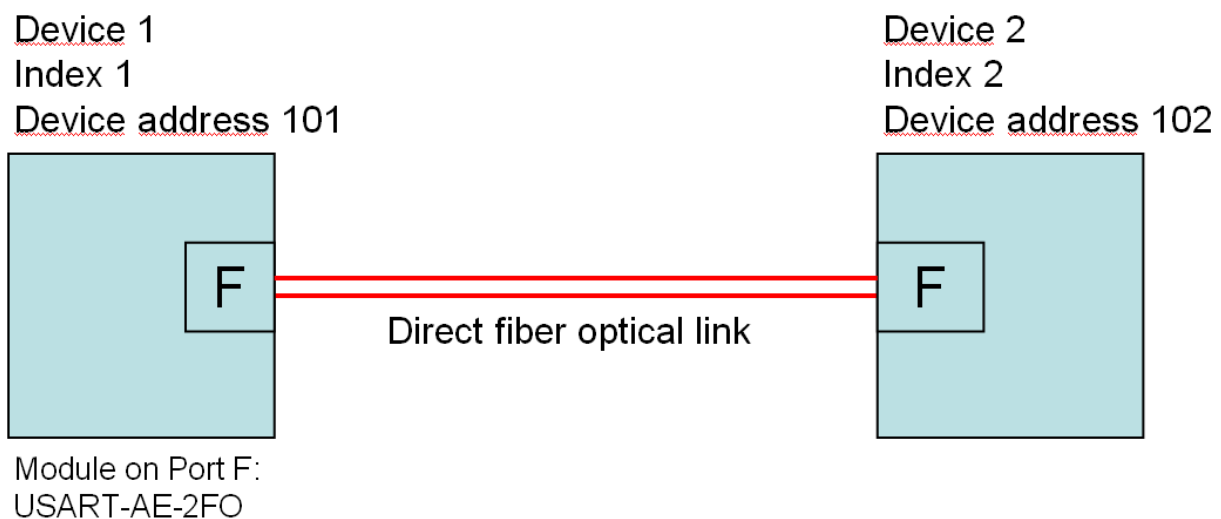


Figure 1: Example of a Protection Interface configuration with direct fiber optical link

1.3.2 Configuration assignment of device 1 in DIGSI 5

The communication module configured later with a PI - interface is taken from the hardware catalogue (right side) and assigned to module location F. Different fiber optical interfaces can be used as PI – interface. For short connections or a connection to a communication converter the USART-AD-1FO or USART-AE-2FO will be used. For direct fiber optical connection over single or multimode fiber connections other type of interfaces with 1300 nm or 1550 nm wavelength are available. Best choice for a PI – interface is a direct fiber optical connection. This offers a high bandwidth connection, immunity against external disturbances and no significant delay time for the signal transfer. But also communication networks can be used for the transfer. All properties for transfer over communication networks are considered in the design of the PI – interface like delay time measurement and the permanent supervision of the quality of the data connection.

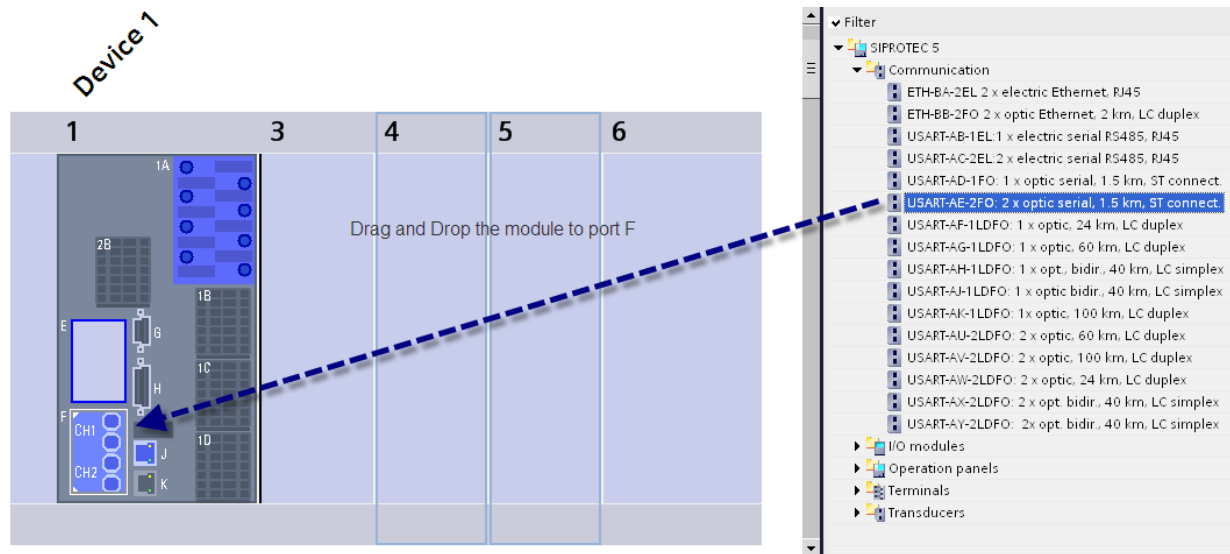


Figure 2: Assignment for module location F for the PI – interface

The settings for the first PI-interface are shown in Figure 3. The PI – interface is handled like a communication protocol which must be assigned to one channel (here channel 1) of the serial communication module (USART – module). For multi terminal (>2) connections two PI-interfaces or two channels of one communication module are required.

After this assignment of the PI-protocol the settings for the PI – interface appear. Detailed explanation for these settings is given in the manual of the devices using the PI – interface (e.g. the line protection devices 7SL8x, 7SD8x and 7SA8x).

The constellation determines how much devices are communicating with each other. Up to six are possible. Each device in a constellation must have a unique address between 1 and 65535. Here device 1 has address number 101 and device 2 number 102. Device 1 is the local device. Important is the 'Lowest appearing bitrate'. This is the slowest data connection in a device constellation and determines the number of data objects which can be transferred between the devices of a constellation. For a direct fiber optical connection it's 2048 kBit/s and therefore the highest value. Limiting value is a 64 kBit/s connection between two devices of a constellation. Especially for a differential protection function running parallel the number of additional data objects is limited. How much data objects are possible will be described for type 1 and type 2 PI-interface in the manual.

SIPROTEC 5 Application

Protection Data Interface Application

Channel 1 protocol settings

Communication protocols
Selected protocol: Protection interface
Default communication mapping: None

Protection interface
Select constellation: 2 device prot. com.

Device combin.

Device combin. settings

31.5131.102	Address of device 1:	101
31.5131.103	Address of device 2:	102
31.5131.101	Local device is device:	1
31.5131.122	Lowest appearing bitrate:	2048 kBit/s

Prot.interface

Prot.interface settings
101.1031.0.105 Connection via...: fiber optic

Prot. interf.1

Prot. interf.1 settings

31.5161.1	Mode:	on
31.5161.105	Max. error rate per hour:	1.000 %
31.5161.106	Max. error rate per min:	1.000 %
31.5161.107	Disturbance alarm after:	0.100 s
31.5161.108	Transm. fail. alarm after:	6.000 s
31.5161.109	Delay time threshold:	30.000 ms
31.5161.110	Difference Tx and Rx time:	0.100 ms
31.5161.113	PPS synchronization:	PPS sync. off

Fallback times

Fallback times for priority levels

Remote data prio. 1:	2.00 s
Remote data prio. 2:	2.00 s
Remote data prio. 3:	2.00 s

Figure 3: Settings for the PI-interface on module location F for device 1

1.3.3 Configuration of device 2 in DIGSI 5

In device 2 we are using the same module and the same settings except one value. Fig. 4 show the difference in the settings for the PI – interface for device 2.

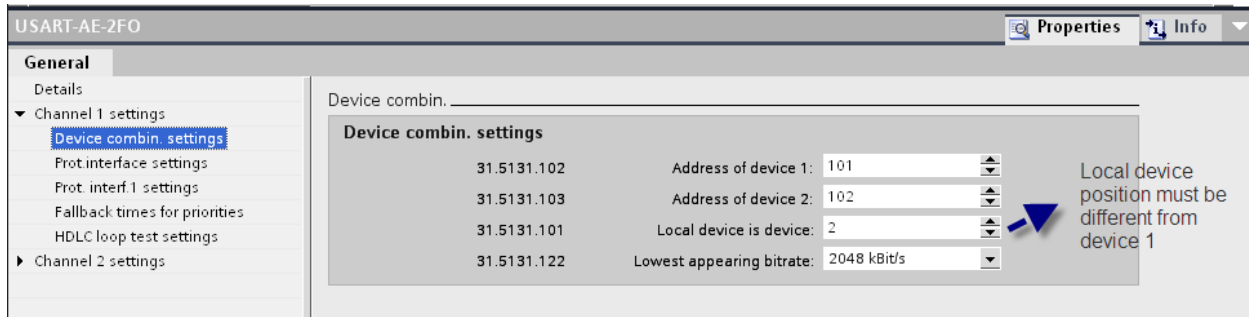


Figure 4: Settings for the PI-interface on module location F for device 2

1.3.4 Principle of the data transfer via the protection interface

Depending on the available bit rate between the devices and the type of the interface (differential (type 1) or non-differential (type 2)) signals and measurements can be freely assigned in DIGSI 5 in a communication mapping editor. These values are transferred between devices belonging to a constellation with a common communication topology.

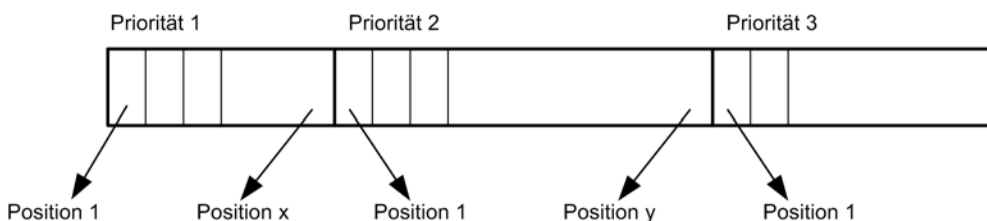


Figure 5: Principle of the data transfer via the protection data interface

The signals (data objects) can be assigned in different priority levels. The amount of signals for each level is limited by the 'Lowest appearing bitrate' and checked by DIGSI 5 according to this setting. Please be sure this setting is valid from beginning and equal in each device of a constellation. If this setting is wrong the values in the communication matrix can not be transferred over the physical connection between the devices if the bandwidth is not available for one connection.

Signals assigned with priority 1 are send with every telegram (5 – 10 ms). Signals and measurements with priority 2 are send with every 2. telegram (10 – 20 ms). Signals and measurements with priority level 3 are send latest every 100 ms. Each signal or measurement must be assigned to a specific position inside a priority level. If e.g. a trip signal from device 1 (single point indication) is assigned to priority 1 and position 1 the other device can read the information from this position (see Fig. 5). Device 2 may assign a trip signal to priority 1 and position 2, but not to position 1, because this position is already used by device 1. So all devices share this bit – strip which is always transferred between the devices and updated by the devices. A single point indication covers one bit (position). A double point indication 2 bits and a measurement 32 bits. Important to know is that at the receiving device a data object from the same type must be configured for the reception of this data object. Normally this is a preconfigured blocking input or a user defined signal.

Because devices connected over PI-interfaces are located in different substations and different DIGSI 5 projects there are no plausibility checks for the data objects configured to the PI-interface. It's under the responsibility of the user to configure for a send data object inside a priority the same type of data object for the receiving device on the same bit – position.

SIPROTEC 5 Application

Protection Data Interface Application

Fig. 3 shows settings for the fallback times for each priority which are valid for all received data objects assigned to this priority. If a loss of communication is detected by the receiving device after this time the value of the data object can be set to a safe state (e.g. a blocking signal with state '1' can be set to '0').

1.3.5 Assignment of signals to the PI - communication mapping

Existing signals from integrated functions (e.g. protection functions or control functions) or user defined signals can be assigned to the PI – interface in the mapping editor.

The screenshot shows the 'Communication mapping' window for 'Project2' and '7SP11'. It displays a table with columns for 'Signals', 'Number', 'Type', 'Signal', 'R', 'Priority level', 'Bit position', 'Fallback value', 'T', 'Priority level', and 'Bit position'. The table is divided into two sections: 'Receive' and 'Transmit'. The 'Receive' section shows signals from device 1 (e.g., Binary inputs 1-11, Binary outputs, F:USART-AE-2FO, J:Integrated Ethernet interface, 2 device prot. com., Line 1) and signals from device 2 (e.g., Block stage, Inactive, Remote stage inactive, Behavior, Health, Pickup, Operate, I diff., phs A, phs B, phs C, I restr., Mode, Operate & ftr.rec. block., Threshold, Thresh. switch onto fault). The 'Transmit' section shows signals from device 1 (e.g., Binary inputs 1-11, Binary outputs, F:USART-AE-2FO, J:Integrated Ethernet interface, 2 device prot. com., Line 1) and signals from device 2 (e.g., Block stage, Inactive, Remote stage inactive, Behavior, Health, Pickup, Operate, I diff., phs A, phs B, phs C, I restr., Mode, Operate & ftr.rec. block., Threshold, Thresh. switch onto fault). The table is filtered to show only 'All entries' and 'Show protocol 2 device prot. com.'.

Signals	Number	Type	Signal	R	Priority level	Bit position	Fallback value	T	Priority level	Bit position
Binary inputs	61.1051									
Binary input1	61.1051.3151									
Value	61.1051.3151...	SPS						X	1	1
Binary input2	61.1051.3152									
Value	61.1051.3152...	SPS						X	1	2
Binary input3	61.1051.3153									
Binary input4	61.1051.3154									
Binary input5	61.1051.3155									
Binary input6	61.1051.3156									
Binary input7	61.1051.3157									
Binary input8	61.1051.3158									
Binary input9	61.1051.3159									
Binary input10	61.1051.3160									
Binary input11	61.1051.3161									
Binary outputs	61.1061									
F:USART-AE-2FO	101									
J:Integrated Ethernet interface	102									
2 device prot. com.	31									
Line 1	21									
General	21.9001									
Group indicat.	21.4501									
Process monitor	21.1131									
Operational values	21.761									
Fund./sym.comp.	21.771									
Energy	21.1021									
87 Line diff. prot.	21.831									
Group indicat.	21.831.4501									
General	21.831.2311									
I-DIFF	21.831.3451									
Block stage	21.831.3451...	SPS		X	1	7				
Inactive	21.831.3451...	SPS								
Remote stage inactive	21.831.3451...	SPS								
Behavior	21.831.3451...	ENS								
Health	21.831.3451...	ENS								
Pickup	21.831.3451...	ACD								
Operate	21.831.3451...	ACT						X	1	3
I diff.	21.831.3451...	WYE	*							
phs A		MV	X					X	3	1
phs B		MV	X					X	3	33
phs C		MV	X					X	3	65
I restr.	21.831.3451...	WYE	*							
Mode	21.831.3451...	ENG								
Operate & ftr.rec. block.	21.831.3451...	ENG								
Threshold	21.831.3451...	ASG								
Thresh. switch onto fault	21.831.3451...	ASG								

Figure 6: Assignment of data objects to the PI – interface in a communication mapping

Figure 6 shows an example for device 1. The value of binary input (BI) 1 and 2 of device 1 is assigned to priority level 1 (high) and Bit position 1 and 2. Because a BI is a Single Point Signal (Type - SPS) two bit positions are necessary for two BI-inputs. In device 2 the state of the binary inputs must be received from position 1 and 2 if it shall be assigned e.g. to a trip contact or used in other applications as an input (e.g. for blocking or intertripping). Furthermore the Operate (trip) signals of the differential protection shall be transferred. This device supports single pole tripping and the Operate signal from type ACT include the three pole trip and phase selected trip signals (4 single point indications). Therefore bit positions 3 – 6 is required. As an alternative only selected trip signals could be transferred (e.g. only 3pole tripping). With priority level 3 (slow) the differential measurement values (MV) are transferred. A measurement value needs 32 Bits (e.g. value 1 bit 1 – 32). Furthermore a signal is received on priority level 1 and bit position 7 coming from device 2. Note, that position 1 – 6 is used by device 1 for transmitting its own signals. Device 2 starts with position 7 in this example and send e.g. a SPS (trip) to device 1 which blocks the differential protection. As an option a

fall back value can be set for each received signal if the communication link fails and no data are received. If no fallback value is assigned the actual value before loss of connection will be kept.

This is an example to show the principle of the assignment of data objects in the communication mapping. In this example priority level 2 is not used. The communication mapping offers a very flexible way to transfer existing and user defined signals between 2 – 6 devices between substations or inside a substation.

1.4 Test features and online supervision

1.4.1 Topology view in DIGSI 5

Once the communication is established between the two devices an editor show all relevant values of the PI – interface in DIGSI 5.

With the topology information you can check if the topology is complete and all devices are communicating with each others. Furthermore you can check if a device is logged OFF and therefore temporally out of service. The device with the lowest device address works as a timing master and can synchronize the time in the other devices of the constellation. This timing master can be checked under the topology information (last entry).

Under device information the local interface values are shown. Under ´Line´ you see if the breaker is closed or open. The value depends if the breaker position is monitored by current values only or with a feedback from the breakers auxiliary contacts or both. Also the delay time between device 1 and 2 is shown. For a short fiber optical link it's nearly to zero. Over a communication network a significant value of several milliseconds may appear. If a 1 s pulse from a GPS – clock is used the delay time in send and receive direction can be measured independent for each direction.

Also the availability of the connection is monitored. It shall be near to 100% otherwise the communication connection shall be checked. There is also an alarm threshold as a setting (see figure 3). If such an alarm appears as a failure indication you can check the value here.

substation is provided by this feature. E.g. the line angle of a long line can be checked because the devices connected via PI – interfaces are exactly time synchronized with an accuracy of 10 μ s.

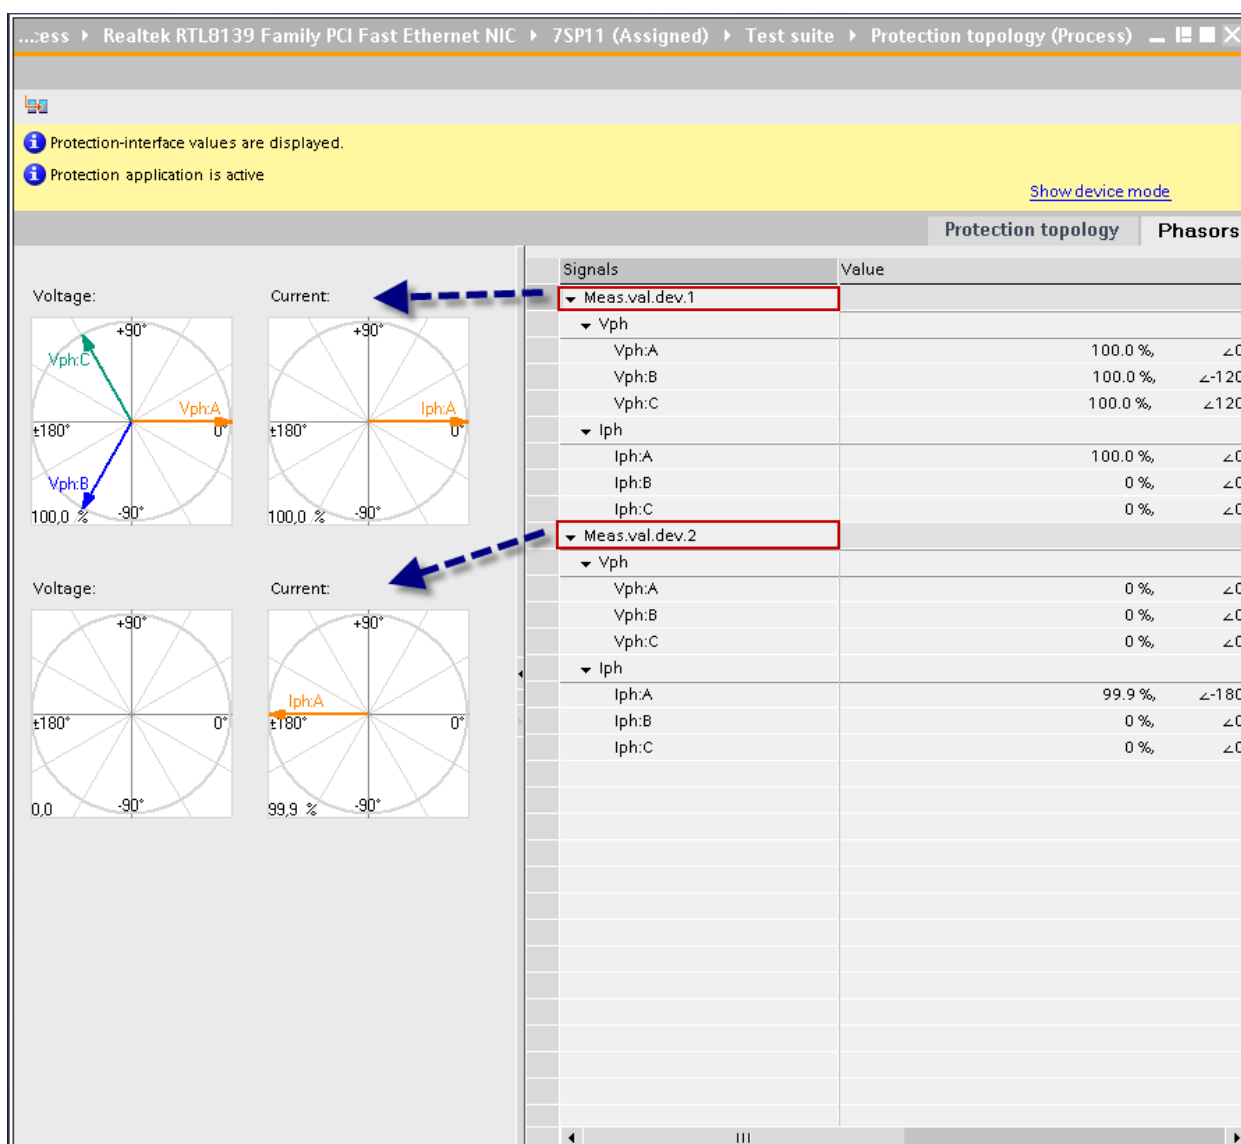


Figure 8: Test editor for voltage and currents of a device constellation connected via PI - interfaces

1.4.3 Communication diagnostic editor

For a detailed check of the communication modules with their configured channels (e.g. PI – interface) a communication diagnostic editor is available in DIGSI 5. For experts a detailed report is available which can be used to find out problems with an interface.

SIPROTEC 5 Application

Protection Data Interface Application

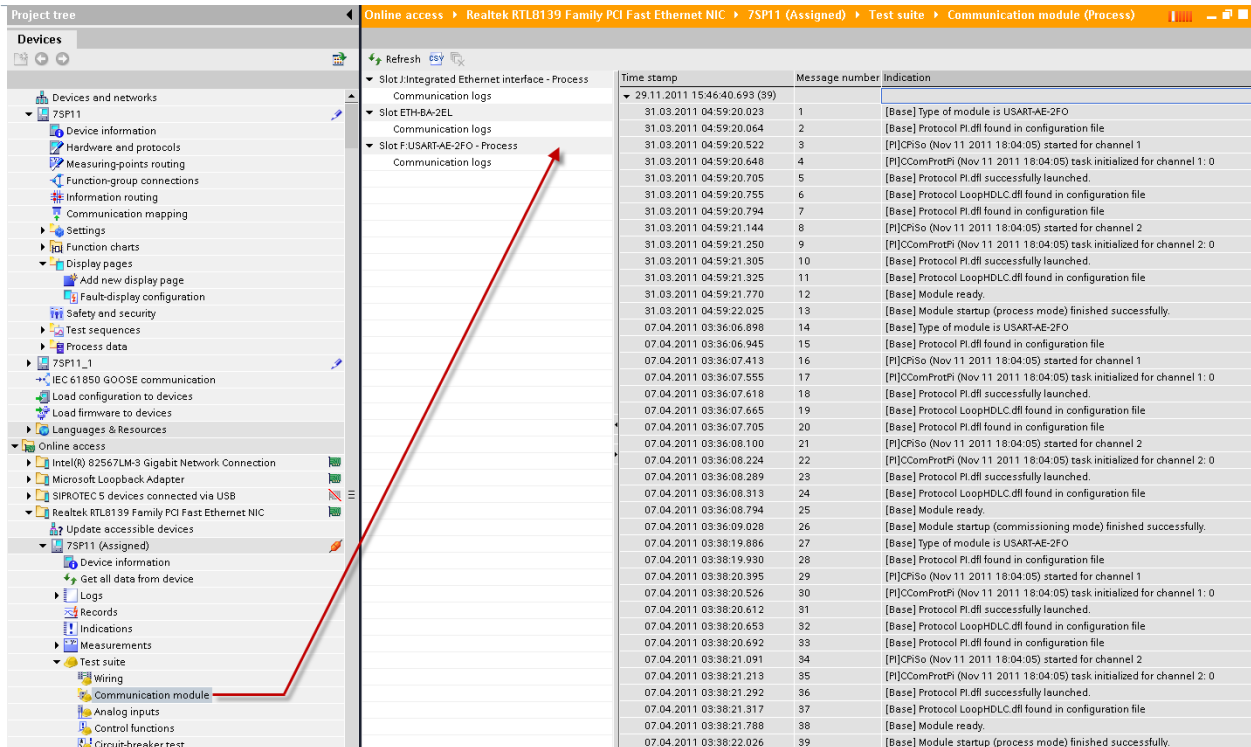


Figure 9: Communication diagnosis editor in DIGSI 5 with a detailed PI-interface report

1.4.4 Loop Test

For the PI – interface a loop test is available. This test can be activated by DIGSI 5. The transmit path of a connection is looped back to the receive path. The device receives its own information which is send out over the transmit path. So the connection can be checked step by step and all supervision values can be used together with this loop test.

SIPROTEC 5 Application

Protection Data Interface Application

Published by and copyright © 2013:

Siemens AG

Infrastructure & Cities Sector

Smart Grid Division

Humboldtstr. 59

90459 Nuremberg, Germany

Siemens AG

Infrastructure & Cities Sector

Smart Grid Division

Energy Automation

Humboldtstr. 59

90459 Nuremberg, Germany

www.siemens.com/protection

Printed on elementary chlorine-free bleached paper.

All rights reserved.

If not stated otherwise on the individual pages of this catalog, we reserve the right to include modifications, especially regarding the stated values, dimensions and weights. Drawings are not binding.

All product designations used are trademarks or product names of Siemens AG or other suppliers.

If not stated otherwise, all dimensions in this catalog are given in mm.

Subject to change without prior notice.

The information in this document contains general descriptions of the technical options available, which may not apply in all cases. The required technical options should therefore be specified in the contract.

For more information, please contact
our Customer Support Center.

Tel.: +49 180 524 8437

Fax: +49 180 524 24 71

(Charges depending on provider)

E-mail: support.ic@siemens.com

Application note: SIP5-APN-005